


## Aboveground ASME Tanks - Spacing

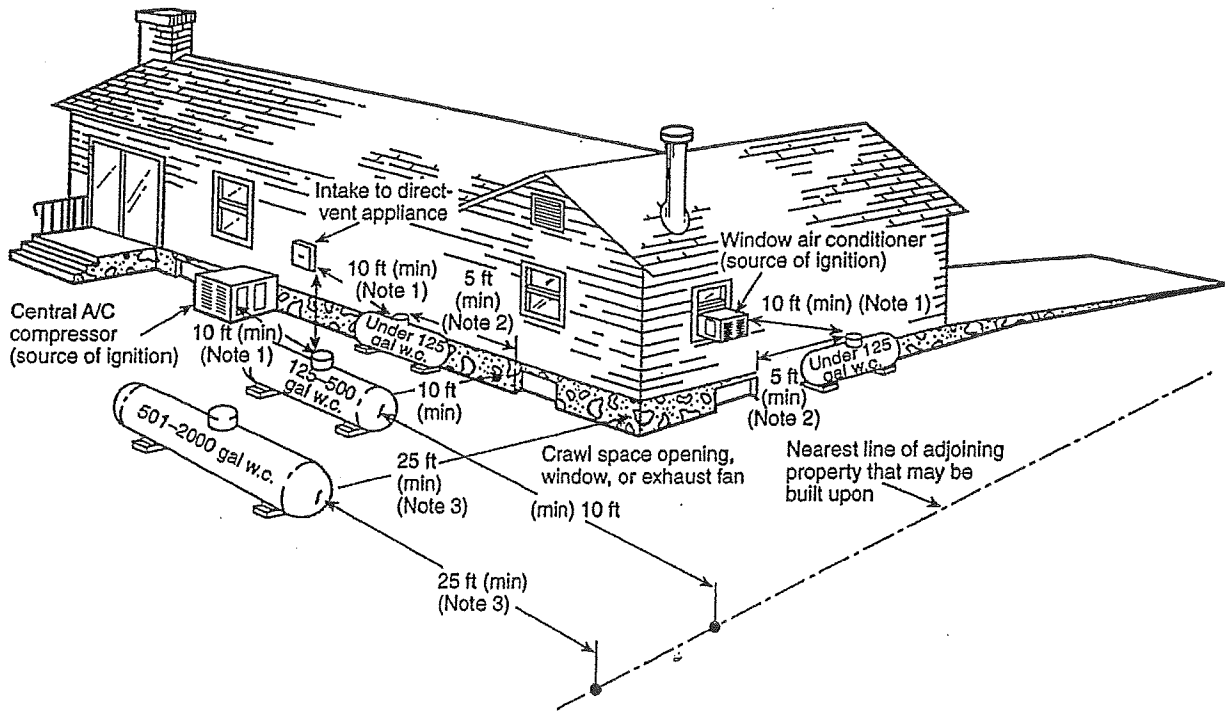


**Notes:**

- 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliances, or intake to a mechanical ventilation system. Refer to 6.3.9.
- 2: Refer to 6.3.9.
- 3: This distance may be reduced to no less than 10 ft for a single container of 1200 gallon water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gallons water capacity. Refer to 6.3.3.

### NFPA 58, 2004 Edition, Annex I, Figure I.1(b) Aboveground ASME Containers

(This figure for illustrative purposes only; local approved codes, regulations and the Authority Having Jurisdiction shall govern)

## Underground ASME Tanks - Spacing

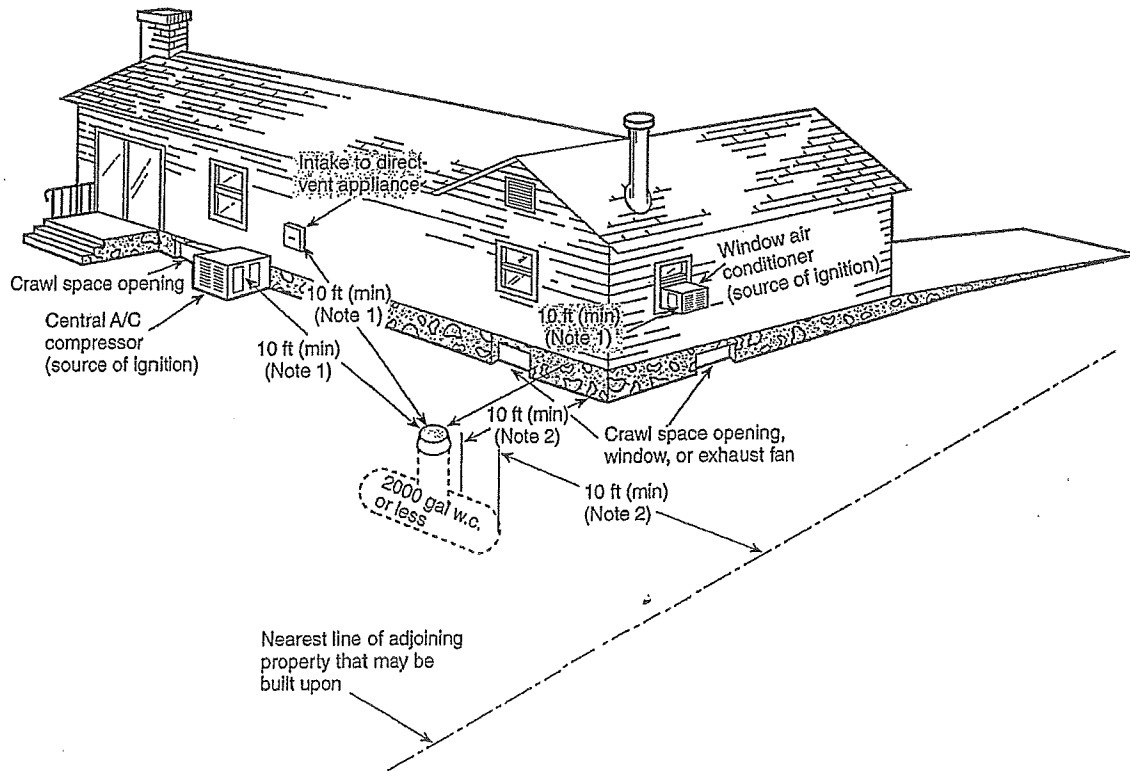

### Notes:

- 1: The relief valve, filling connection, and liquid fixed maximum level gauge vent connection at the container must be at least 10 ft from any exterior source of ignition, openings into direct-vent appliances, or mechanical ventilation air intakes. Refer to 6.3.4.
- 2: No part of an underground container shall be less than 10 ft from an important building or line of adjoining property that can be built upon. Refer to 6.3.4.

### NFPA 58, 2004 Edition, Annex I, Figure I.1(c) Underground ASME Containers

(This figure for illustrative purposes only; local approved codes, regulations and the Authority Having Jurisdiction shall govern)